


SYMBOL LEGEND

-  WALL MOUNT OCCUPANCY SENSOR LIGHT SWITCH
-  J-BOX IN WALL (NON POWERED)
-  120 V 20 AMP DUPLEX RECEPTACLE
-  RECEPTACLE INSTALLED @ 42" AFF
-  120 V 20 AMP CEILING MOUNT DUPLEX RECEPTACLE
-  RECESSED FLUORESCENT LIGHT FIXTURE W/ 3-25W BULBS
-  CEILING MOUNT EXHAUST FAN - SEE PLAN FOR CFM RATING
-  24"x24" RETURN AIR CEILING REGISTER W/ CHARCOAL FILTERS
-  24"x24" SUPPLY AIR CEILING REGISTER
-  6" Ø SUPPLY AIR CEILING REGISTER
-  FLUSH MOUNT 120 / 240 V 1 Ø ELECTRICAL PANEL
-  WALL MT 7-DAY PROGRAMMABLE THERMOSTAT
-  EXTERIOR REMOTE HEAD EMERGENCY LIGHT
-  CEILING MT COMBO LIGHTED EXIT SIGN / EMERGENCY LIGHT 90 MINUTE CAPACITY
-  60 W EXTERIOR PORCH LIGHT W/ PHOTO CELL, WEATHER PROOF
-  10 # ABC FIRE EXTINGUISHER
-  FLOOR DRAIN W/ TRAPGUARD
-  J-BOX IN WALL FOR FIRE ALARM PULL STATION
-  J-BOX IN WALL FOR FIRE ALARM STROBE LIGHT
-  J-BOX IN WALL FOR FIRE ALARM HORN / STROBE LIGHT

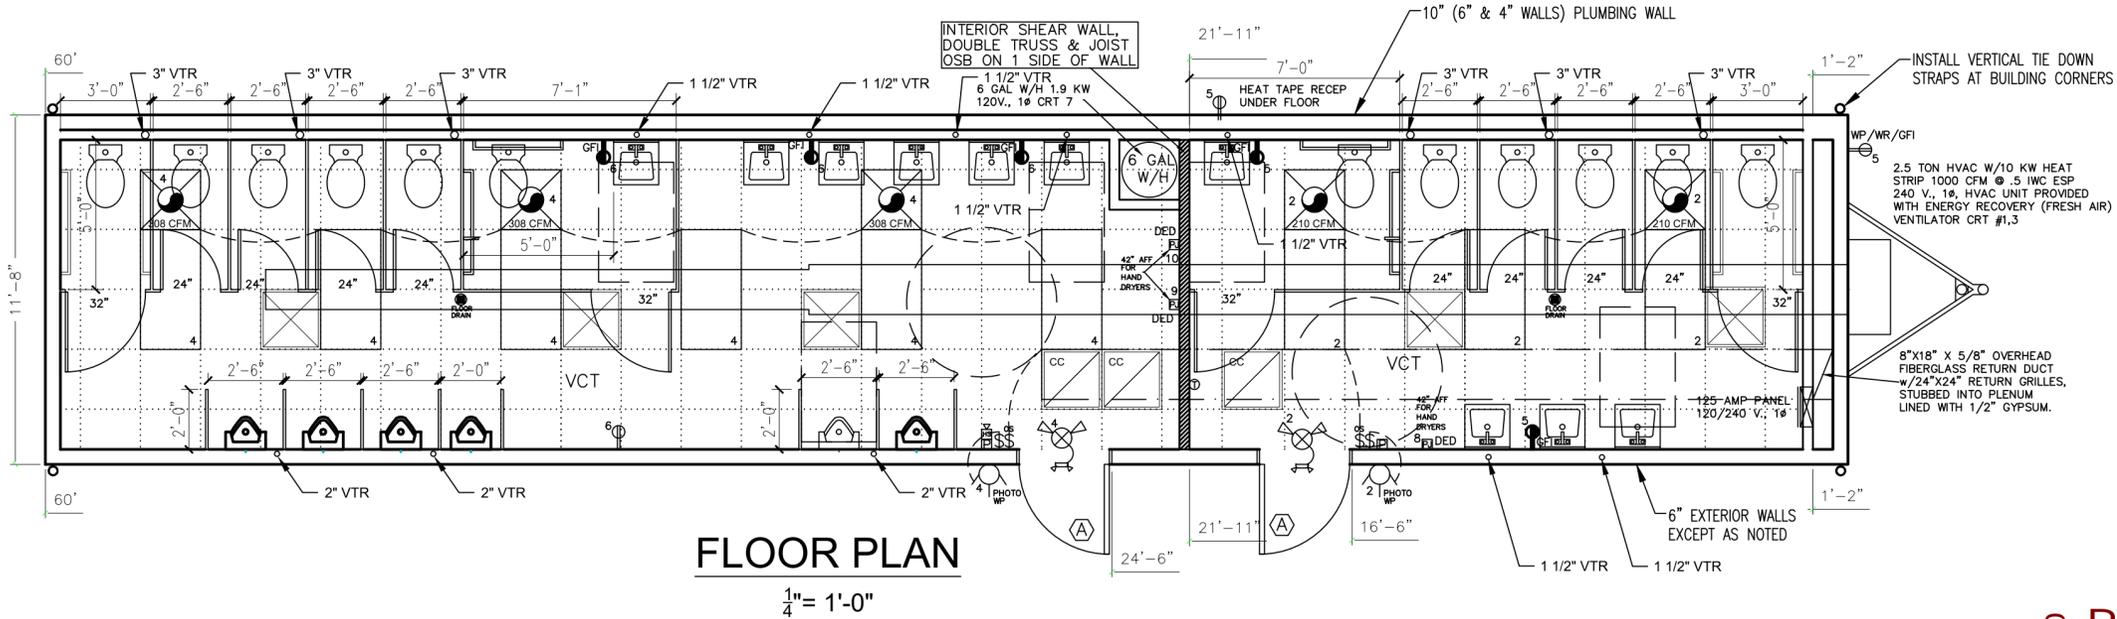

FLOOR PLAN

1/4" = 1'-0"

ELECTRICAL SIZING	120/240V	SGL PHASE	INSTALL	125 AMP PANEL
PANEL BOX				
ID	QTY	UNITS	KW	SUB-TOTAL
HVAC 2.5 TON	1	EACH	10.6	10.6
WATER HEATER	1	EACH	2.4	2.4
LIGHTS	700	SQ FT	0.0035	3.1
RECEPTACLES	8	EACH	0.18	1.4
EXHAUST FANS	5	EACH	0.4	2.0
DEDICATED CIRCUITS	3	EACH	1.9	5.7
		TOTAL =	25.2	KW
		TOTAL =	105.0	AMPS

ELECTRICAL PANEL SCHEDULE			
CIRCUIT ID	DESCRIPTION	BREAKER	WIRE
1,3	HVAC 2.5 TON	60A (2P) HACR	6-6-10 MC
2, 4	LIGHTS	20A	12
5, 6	RECEPTACLES	20A	12
8, 9, 10	DEDICATED CKTS	20A	12

DOOR SCHEDULE		WINDOW SCHEDULE	
	3680 - STEEL DOOR W/6"x30" SAFETY GLASS VIEW BLOCK - STEEL JAMB - CLOSER - LEVER HARDWARE		

ELEVATION NOTES:

- FOUNDATION ENCLOSURE (WHEN PROVIDED) MUST HAVE 1 SQ FT NET VENT AREA PER 1 / 150 TH OF THE FLOOR AREA, AND AN 18"x24" MINIMUM CRAWL SPACE ACCESS, INSTALLED BY OTHERS SUBJECT TO LOCAL JURISDICTION. SEE CROSS SECTION FOR METHOD OF ROOF VENTILATION.
- ACCESSIBLE RAMP(S), STAIR(S) AND HANDRAILS ARE SITE INSTALLED, DESIGNED BY OTHERS, AND SUBJECT TO LOCAL JURISDICTION.

APPROVED **RADCO** **APPROVED**

Oct 19, 2017

RADCO
5801 Benjamin Center Dr. Suite 102
Tampa, FL 33634-5206
P: (813) 243-0370 F: (813) 243-1314

REVIEWED BY:
MICHAEL A. FREY
Michael A. Frey
FLORIDA MODULAR PLANS EXAMINER
NO. SMP 37


LISTING AGENCY APPROVAL

THESE PRINTS COMPLY WITH THE FLORIDA MANUFACTURED BUILDING ACT OF 1979 CONSTRUCTION CODE AND ADHERE TO THE FOLLOWING CRITERIA.


CONST. TYPE	V(B)
OCCUPANCY	BUSINESS
FLOOR LL	50 PSF
WIND VELOCITY	160 (ULT) MPH
FIRE RATING OF EXT. WALLS	0
ALLOWABLE NO. OF FLOORS	1
MANUFACTURER	TMS
PLAN NUMBER	TMS-3595
APPROVAL DATE	Oct 19, 2017
HVHZ ZONE	NO

RADCO


NOTE:
THIS BUILDING IS ONE OF A GROUP OF SEVEN (TMS-3590, 3591, 3592, 3593, 3594, 3595 & 3596) WHICH ARE SUPPORTED BY A TOILET TRAILER, MODULAR BUILDING TMS-3595. TOILET TRAILER IS LOCATED WITHIN 500 FEET OF ALL BUILDINGS WITHOUT ADEQUATE PLUMBING FACILITIES AND IS HANDICAP ACCESSIBLE.

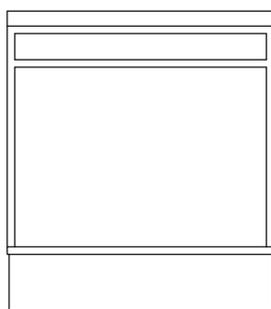


LEFT ELEVATION

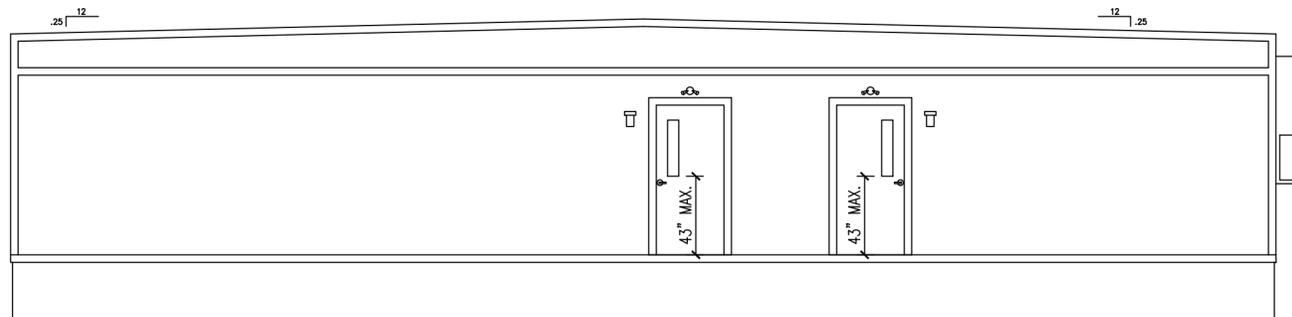


FRONT ELEVATION

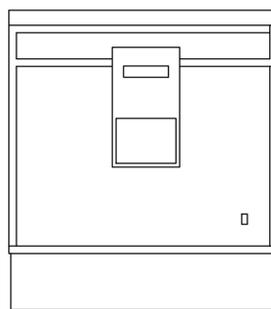

RIGHT ELEVATION

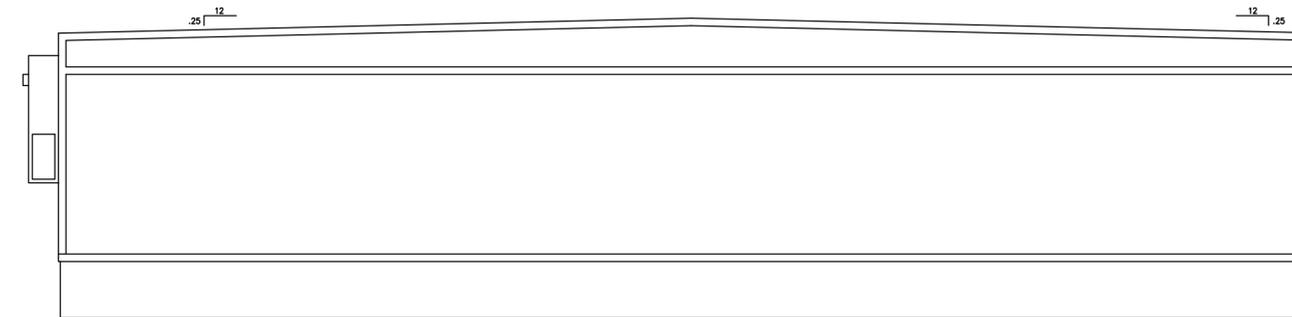

REAR ELEVATION



TITAN MODULAR SYSTEMS, INC.	
162 INDUSTRIAL DRIVE * ALMA, GA 31510 912-632-3344 (PH) * 912-632-3345 (FX)	
DATE: 10-16-17	ENGINEER: JAMES ALLEN CHAPMAN, P.E.
SCALE: AS NOTED	
CODES: FL	
TMS-3595 - 11'-8"x60' - BUSINESS	
FLOOR PLAN & ELEV	PAGE: 3 / 5